


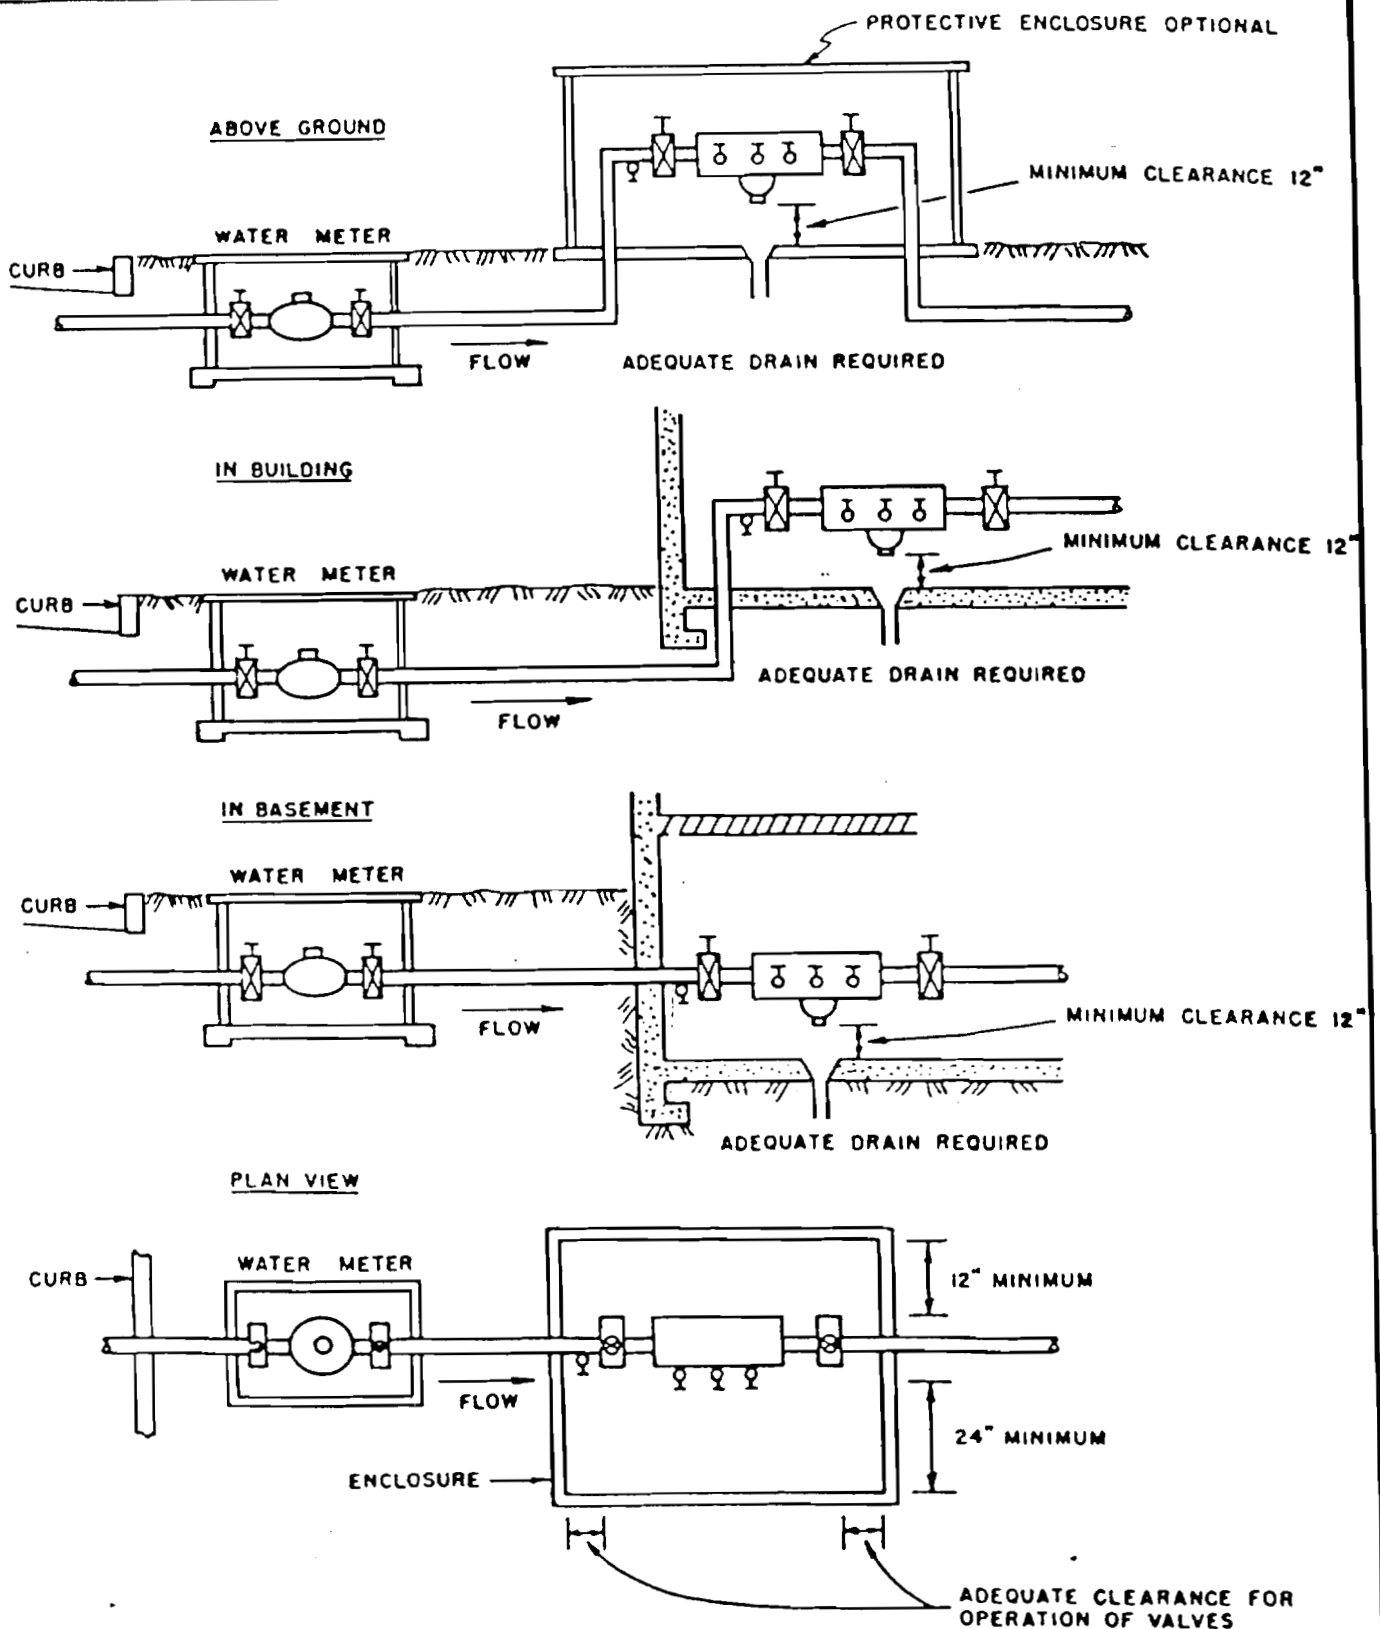

TYPICAL INSTALLATIONS WITH MINIMUM CLEARANCES
REDUCED PRESSURE PRINCIPLE DEVICES

CITY OF UKIAH

BACKFLOW PREVENTION DETAIL
REDUCED PRESSURE PRINCIPAL DEVICES

Scale: None	Drawn By: JHY	Approved By: 4/88 R. Pedroncelli	Drawing No. 382
Date: June, 1967	Revised:		