


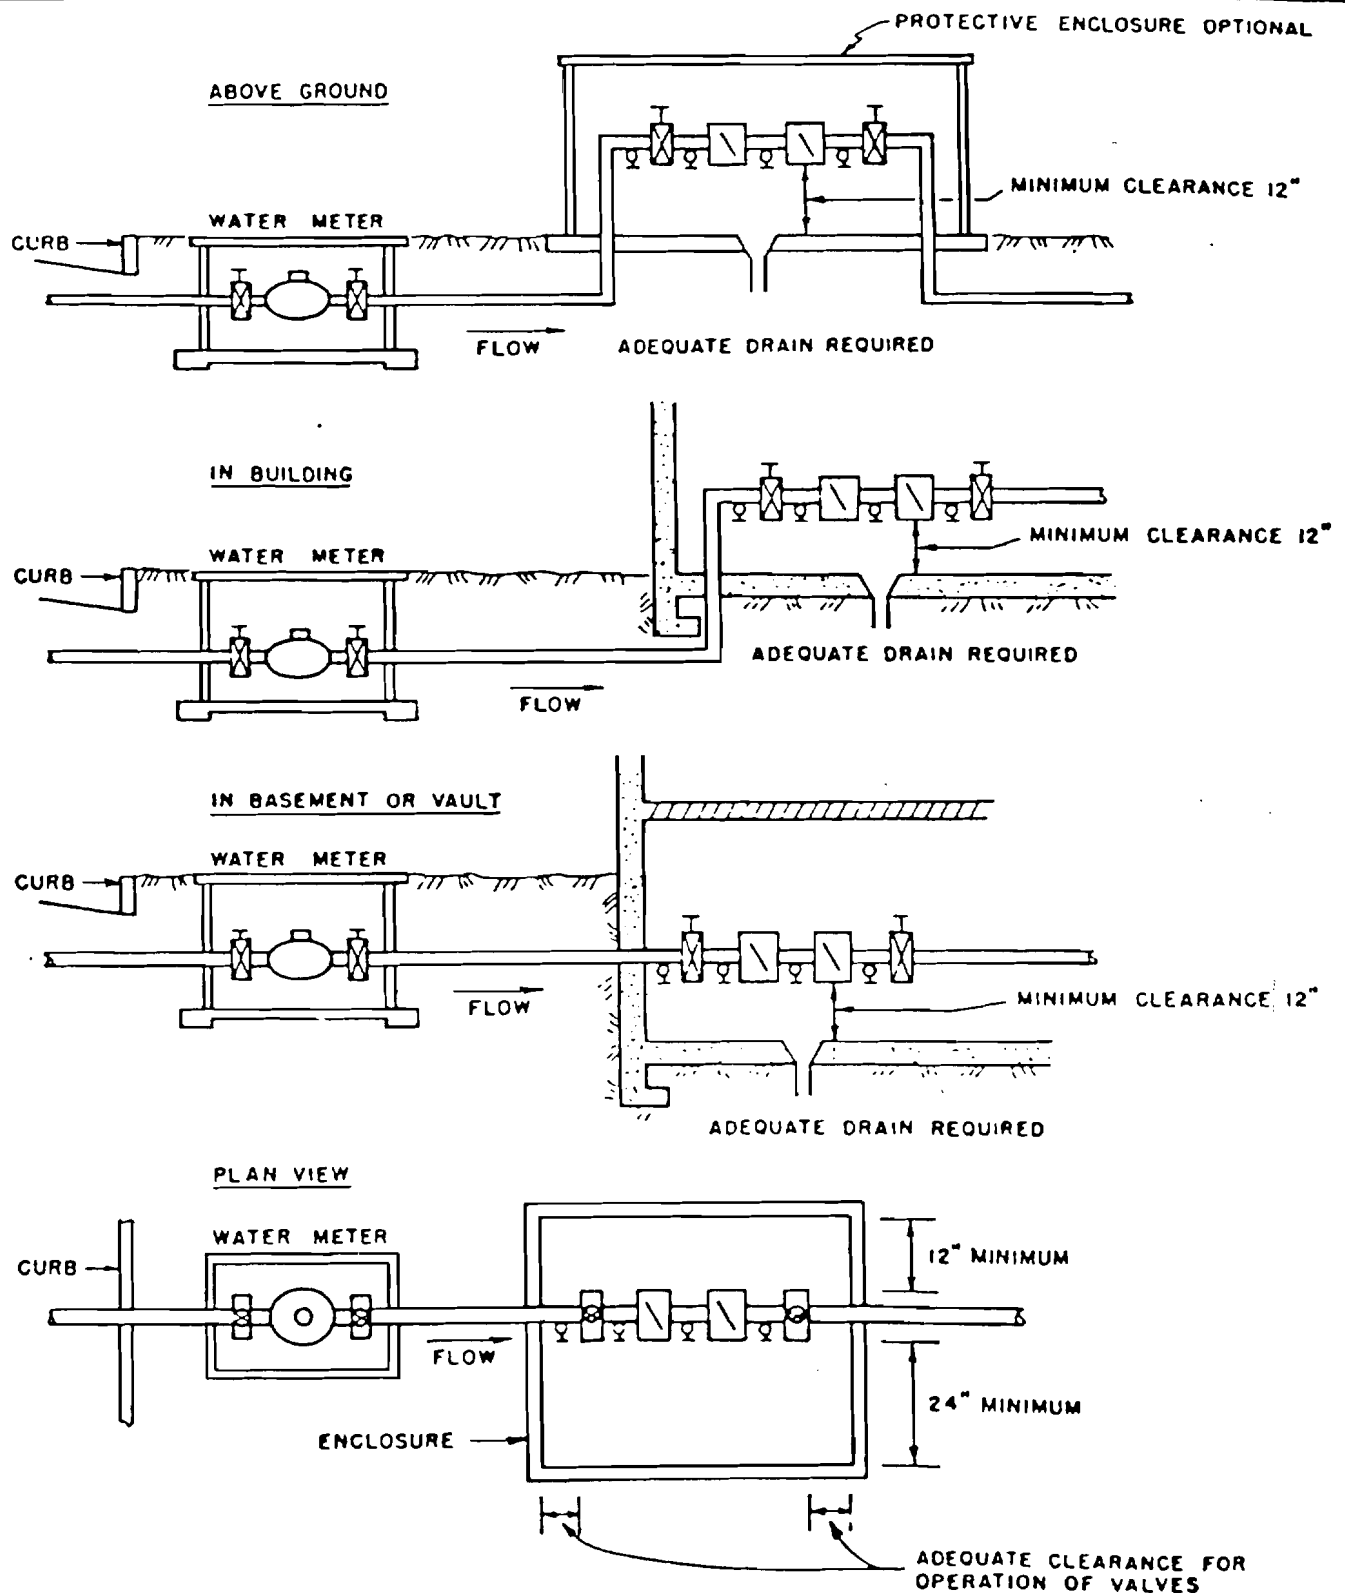

TYPICAL INSTALLATIONS WITH MINIMUM CLEARANCES
DOUBLE CHECK VALVE ASSEMBLIES

CITY OF UKIAH

BACKFLOW PREVENTION DETAILS
DOUBLE CHECK VALVE ASSEMBLIES

Scale: None	Drawn By: JHY	Approved By: 4/88	Drawing No.
Date: June, 1987	Revised:	R. Pedronelli	383