


**WATER TANK NOTES**

- NO BUILDING PERMIT IS REQUIRED FOR WATER TANKS SUPPORTED DIRECTLY ON GRADE IF IT IS LESS THAN 5,000 GALLONS AND THE RATIO OF HEIGHT TO DIAMETER OR WIDTH DOES NOT EXCEED 2:1. FOR TANKS THAT DO NOT MEET THE ABOVE A BUILDING PERMIT AND CONCRETE FOUNDATION IS REQUIRED.

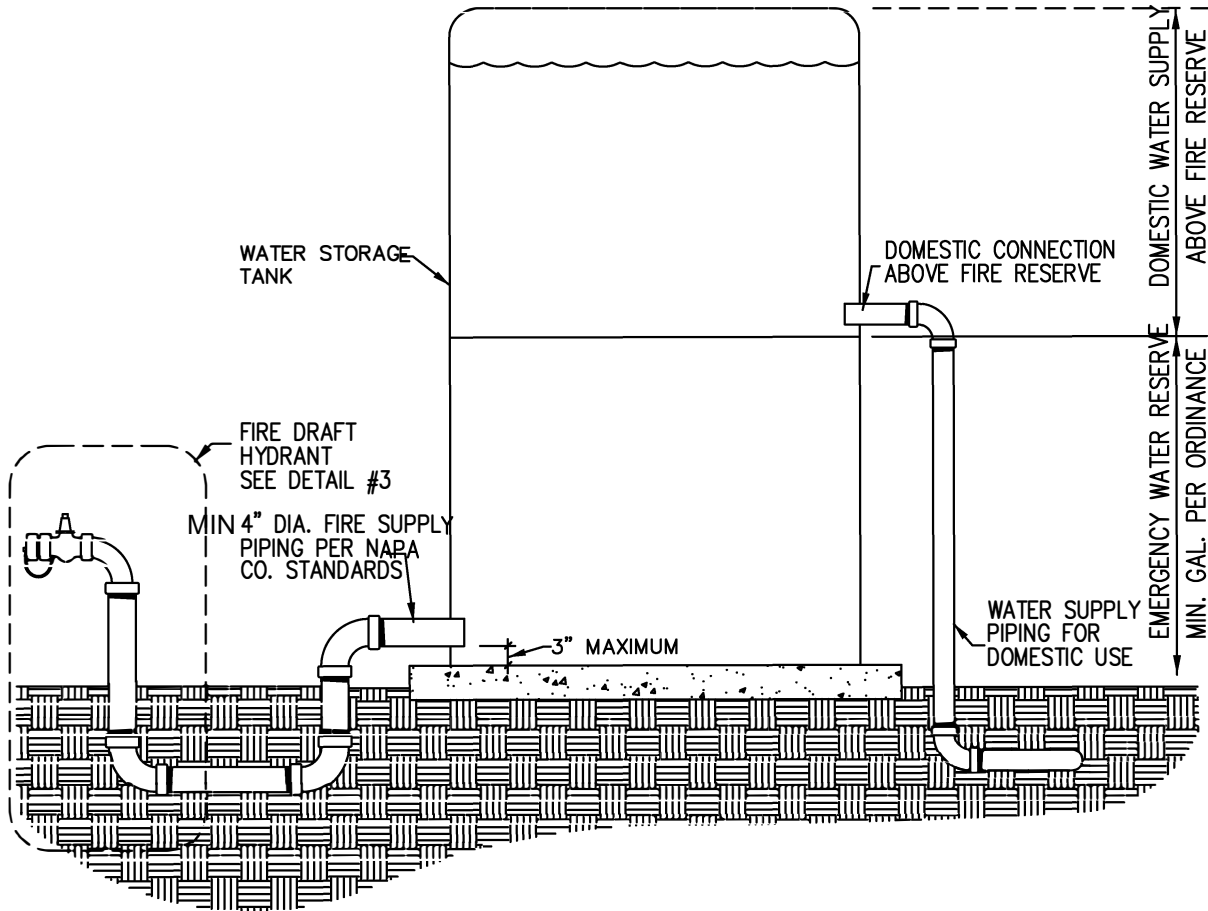

**WATER STORAGE TANK**

**WATER SUPPLY NOTES**

- FOR WATER TANK STORAGE CAPACITY REQUIREMENTS REFER TO NFPA 1142 / 2022 CFC
- WHEN MULTIPLE WATER TANKS ARE UTILIZED TO ACHIEVE THE REQUIRED VOLUME OF WATER, THE CONNECTION BETWEEN THE TANKS SHALL BE BY AN APPROVED **MIN** 4" DIA. WATER LINE.

**RESIDENTIAL WATER SUPPLY FROM TANK**

Ukiah Valley Fire Authority



**FIRE SAFE STANDARDS**

DATE: 12/8/22

REVISED:

APPROVED

**4**